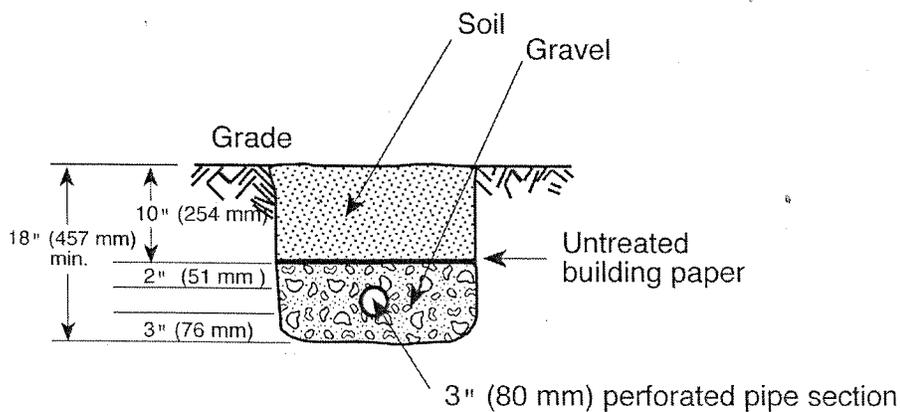


Note: Each valved zone shall have a minimum effective absorption/irrigation area in square feet predicated on the estimated graywater discharge in gallons per day and on the type of soil found in the area. The area of the field shall be equal to the aggregate length of perforated pipe sections within the valved zone times the width of the proposed field.



**Figure G-5**  
 Graywater System Typical Irrigation Layout (conceptual)